




BRITISH WATER
expertise worldwide



Code of Practice

Flows and Loads – 4

Sizing Criteria, Treatment Capacity for Sewage Treatment Systems

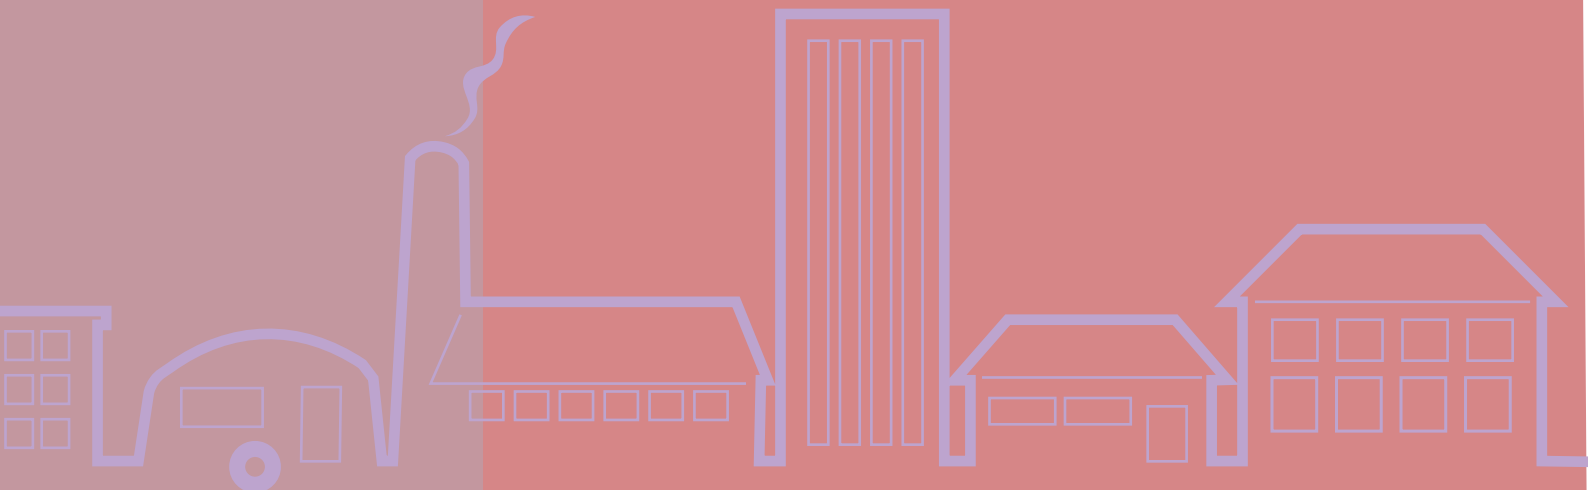

Southbank House
Black Prince Road
London SE1 7SJ
www.britishwater.co.uk

BW COP: 18.11/13

ISBN 978-1-903481-10-3



Code of Practice

Flows and Loads – Sizing Criteria, Treatment Capacity for Sewage Treatment Systems

This code of practice was prepared by the British Water Package Sewage Treatment Plant Focus Group comprising manufacturers, suppliers and service companies of all types of small wastewater treatment systems.

The Environment Agency, the Northern Ireland Environment Agency and the Scottish Environment Protection Agency support the use of this code of practice, but the Agencies do not specifically endorse any particular manufacturer's product.

This code of practice provides a table of loadings which allows the total daily sewage load from properties to be calculated and it is recommended that all designers should use this table when sizing and designing non-mains sewage treatment systems. The flows and loads values given represent current best knowledge within the UK but may change with time in line with per capita water use.

Where proposed alternative usage rates or methods of sizing might be more appropriate for a particular application this should be supported by the collection of data or additional site specific evidence to validate the proposal. Professional judgment is required and may be used to compare alternatives especially when assessing sewage strengths and treatability.

Guidance is provided to assist the user to identify the various sources of sewage, to consider the nature of the sewage to be treated and to make users aware of issues which may affect treatability and system performance. Each manufacturer is aware of the capabilities of their own systems with respect to different situations.

The table of loadings may be used to design all sizes of sewage treatment systems serving up to 1000 population.

Use of this code of practice by all UK manufacturers and system designers will:

- help to clearly define site activity and sewage sources
- promote a consistent approach to collecting accurate and complete loading information
- provide consistent information about problem effluents and treatability, and
- promote the design and installation of appropriate treatment systems and so reduce the problem of undersized systems causing environmental contamination.

The loadings in this code of practice are more comprehensive than in previously published guidance, they are generally higher and include values for ammonia.

1 Scope

The purpose of this code of practice is to provide an appropriate table of loadings (volumes and loads) to allow the total daily load entering a treatment system to be calculated.

2 Regulations

Early contact with the Regulator to discuss the proposed discharge of sewage effluent is advisable.

- Planning requirements, eg *DETR Circular 3/99, site survey, etc.*
- Building regulations, eg part H *DTLR England & Wales, part M Scotland, Water (Northern Ireland) Order 1999 and Northern Ireland building regulations.*
- A Permit, Authorisation or Consent to discharge will be required from the environmental regulators (the Agencies).
- Planning permission (Local Authority Planning Guidance).

3 Definitions of terms

- **Population (P)** – number of people the system will serve.
- **Biochemical oxygen demand (BOD₅)** – Mass concentration of dissolved oxygen consumed under specified conditions (5 days at 20° C with nitrification inhibition) by the biological oxidation of organic and/or inorganic matter in water.
- **Ammonia expressed as mg/l N** – Ammonia is NH₃, Ammonium is NH₄OH. In wastewater we frequently refer to and use the word symbol, ammonia/NH₃. The term ammonia usually includes ammonium as well.

4 Selection considerations – all applications

- Values and conditions required by any regulatory permit or consent.
- Loading figures for each specified load are given for Flow, BOD and NH₃.
- The user/purchaser of the system must declare **ALL ACTIVITIES** to enable all loads entering the treatment system to be identified and evaluated. The user/purchaser should be made aware that there is a risk of poor performance from the equipment if loads are understated. The accuracy of the declared loads is of paramount importance.
- Guidance points given under each category suggest questions to enable the specifier to recognise variable or unusual loads,

particular to that site, to improve correct system selection and design.

- Total daily loadings are calculated based on the anticipated final maximum capacity of the site. New sites initially may have a reduced business level but the system suggested should reflect the full business potential, e.g. a system suggested for a hotel or caravan site or any other application, with an average 80% occupancy rate should be designed to handle 100% occupancy. The equipment selected by the specifier should reflect the maximum potential of the site. Where a specifier is instructed to use lower occupancy rates, this should be recorded. Flow balancing should be considered where appropriate
- Excess disinfectants, chemicals, etc can affect the biological processes as can specific toxic substances from site activities e.g. photographic chemicals, weed killers, motor oils. It is assumed that these substances are excluded from the wastes to be treated.
- Some water treatment equipment effluents eg softeners, chlorinated backwashes may not be acceptable; system designers should specifically accept or exclude their use. Many treatment system designs will accept regenerants into their units, however this must be checked and agreed.
- Water saving devices affect sewage strength, the impact of their installation should be identified.
- Laundries affect sewage strength and treatability; their proportion should be identified.
- Surface/storm water is not permitted as part of the wastewater stream and must be excluded.
- It is assumed, unless stated, that waste disposal units (WDU) are not in use.
- Undersizing of equipment is to be avoided as it is always better to have a plant slightly oversized, rather than on the limit or undersized.

■ **The owner of the treatment system holds the permit, consent or authorisation to discharge and should be aware that he is responsible for the effluent quality discharged. Thus all sources of discharge into the system must be declared. It is an offence if the effluent fails to comply with the regulators requirements.**

(continued on page 4)



Table of Loadings for Sewage Treatment Systems

| Per person / activity / day (unless otherwise specified) | FLOW (Litres) | BOD (Grams) | Ammonia as N |
|---|---------------------|----------------|-----------------|
| DOMESTIC DWELLINGS (Grams) | | | |
| Standard residential | 150 | 60 | 8 |
| Mobile home type caravans with full services | 150 | 60 | 8 |
| INDUSTRIAL | | | |
| Office / Factory without canteen | 50 | 25 | 5 |
| Office / Factory with canteen | 100 | 38 | 5 |
| Open industrial site, e.g. construction, quarry, without canteen | 60 | 25 | 5 |
| *Full-time Day Staff | 90 | 38 | 5 |
| *Part-time Staff (4 hr shift) | 45 | 25 | 3 |
| SCHOOLS | | | |
| Non-residential with canteen cooking on site | 90 | 38 | 5 |
| Non-residential without a canteen | 50 | 25 | 5 |
| Boarding school (i) residents | 175 | 60 | 8 |
| (ii) day staff (inc. mid-day meal) | 90 | 38 | 5 |
| HOTELS, PUBS & CLUBS | | | |
| Hotel Guests (Prestige hotels) | 300 | 105 | 12 |
| Hotel Guests (3 ^h & 4 ^h hotels) | 250 | 94 | 10 |
| Guests (Bedroom only – no meals) | 80 | 50 | 6 |
| Residential Training/Conference Guest (inclusive all meals) | 350 | 150 | 15 |
| Non residential Conference Guest | 60 | 25 | 2.5 |
| Drinkers | 12 | 15 | 5 |
| Holiday camp chalet resident | 227 | 94 | 10 |
| Resident Staff | 180 | 75 | 10 |
| Restaurants - Full Meals - luxury catering | 30 | 38 | 4 |
| - pre-prepared catering | 25 | 30 | 2.5 |
| - Snack Bars & bar meals | 15 | 19 | 2.5 |
| - Function Rooms including buffets | 15 | 19 | 2.5 |
| - Fast Food i.e. (roadside restaurants) | 12 | 12 | 2.5 |
| - Fast Food Meal (burger chain and similar) | 12 | 15 | 4 |
| Students (Accommodation only) | 100 | 60 | 8 |
| AMENITY SITES | | | |
| Toilet Blocks (per use) | 10 | 12 | 2.5 |
| Toilet (WC) (per use) | 10 | 12 | 2.5 |
| Toilet (Urinal) (per use) | 5 | 12 | 2.5 |
| Toilet Blocks in long stay car parks/lorry parks (per use) | 10 | 19 | 4 |
| Shower (per use) | 40 | 19 | 2 |
| Golf Club | 20 | 19 | 5 |
| Local community sports club, e.g. squash, rugby & football | 40 | 25 | 6 |
| Swimming (where a separate pool exists without an associated sports centre) | 10 | 12 | 2.5 |
| Health Club/Sports Centre | 50 | 19 | 4 |
| Tent sites | 75 | 44 | 8 |
| Caravan Sites - (i) Touring not serviced | 100 | 44 | 8 |
| (ii) Static not serviced | 100 | 44 | 8 |
| (iii) Static fully serviced | 150 | 60 | 8 |
| HOSPITALS & RESIDENTIAL CARE HOMES | | | |
| Residential old people / nursing | 350 | 110 | 13 |
| Small hospitals | 450 | 140 | Assess |
| Large hospitals | Assess individually | | |

*Staff figures also apply to other applications



- After installation, if the system is overloaded, due to activities that were not previously identified by the owner/ purchaser of the system, then the manufacturer may not be able to assist with meeting the legal obligations of the permit provided by the regulator. The regulator has the right to review permits and change them if necessary.
- All sewage treatment system should be maintained according to the manufacturer's instructions by a certified engineer trained in accordance with the British Water Maintenance and Service Code of Practice.

5 Domestic housing

- A treatment system for a single house with **up to and including 3 bedrooms** shall be designed for a minimum population (P) of 5 people.
- The size of a treatment system for a single house with more than 3 bedrooms shall be designed by **adding 1 P for each additional bedroom** to the **minimum single house value of 5 P**, eg:
 - house with 3 bedrooms = **minimum 5 P system**
 - house with 4 bedrooms = **minimum 6 P system (5+1)**
 - house with 6 bedrooms = **minimum 8 P system (5+3)**.
- For groups of small 1 and 2 bedroom houses or flats
 - flat with 1 bedroom = **allow 3 P**
 - flat with 2 bedrooms = **allow 4 P**
- A treatment system serving a group of houses shall be designed by adding together the P values for each house calculated independently, eg:
 - for a group of two houses (3 and 4 bedrooms, respectively) the system shall be for a minimum of 11 P (5+6)
- **If the calculated total P for a group of houses exceeds 12 P then some reduction may be made** to allow for the balancing effects on daily flow of a group of houses (round UP not down)
 - **Where the total is 13-25 P** multiply the total by 0.9 to give an adjusted P value, e.g. if there are four four-bedroom houses the total P will be 24 P (4 x 6) and the adjusted P will be 22 P (24 x 0.9 = 21.6)
 - **Where the total is 26-50 P** multiply the total by 0.8 to give an adjusted P value, e.g. if there are four three-bedroom houses and three four-bedroom houses the total P will be 38 P (4 x 5 and 3 x 6) and the adjusted P will be 31 P (38 x 0.8 = 30.4)
- Where there are larger groups of houses, the P should be estimated using both the expected total load and the flow, considering both peak and total flow
- These are minimum recommended population (P) loads, they should not be modified downwards, upward modification may be necessary because of particular characteristics of each property or groups of properties.
- The above assessments of population (P) should be used for both existing and new properties

- Larger luxurious houses tend to have greater loads and increased water consumption with variability.
- Holiday homes tend to have higher occupancies, with perhaps, lounges also acting as bedrooms. Holiday lets and second homes may be used intermittently
- Check for unusual water uses such as spa baths, home brewing or home photo processing.
- Waste disposal units increase biological load.
- Laundry chemicals and toxic substances will affect the performance. (See below) It is assumed that laundry is not brought in, i.e. Team strips.

6 Commercial Premises

- Identify **ALL** the sources of waste.
- Identify final maximum site usage/business expectations.
- The individual values provided for each function within the table assume that 100% of every application and load is quantified. **DO NOT** reduce values based on reduced expectations.
- All catering applications require the installation of adequately sized grease separators, removal or retention systems up-stream of the biological treatment equipment.

7 Catering premises

- Establish maximum (and minimum) daily load based on a 24 hour cycle.
- Check period of operation.
- Identify dates of maximum loads, e.g. Mothering Sunday, Easter, Bank holidays, Fridays etc.
- Identify load peaks, usually at lunch or evening.

- Flow balancing may provide an appropriate solution.
- Where WDU and potato peelers are to be used calculate/document the load.
- Identify the nature(s) of the catering in order to select the correct loading, eg

| | |
|--------------------------|--|
| ■ Bar snacks | - ploughmans, sandwiches, basket meals, etc. |
| ■ Pre-prepared catering | - frozen and chilled meals (not prepared on site). |
| ■ Home cooked meals | - fresh soups, fresh vegetables, casseroles, etc. |
| ■ Luxury catering | - fully prepared on site with cream sauces, home made desserts. |
| ■ Takeaways | - Indian, Chinese, fish and chips, etc. |
| ■ Fast food | - roadside restaurants, burger chains, etc. |
| ■ Function room catering | - Establish "normal" style, may be sandwiches, or full buffet, home cooked meals, conference, wedding banquets, etc. |
- The biological unit must be protected from grease and fats. Modern cooking uses light oils, which may not separate. The collection and containment of all forms of grease prior to the biological equipment is vital. Operate any grease system in full accordance with the manufacturer's instructions.
- Individual kitchen practices affect loads, i.e. leftovers on plates may be scraped into bins, or wet rinsed into system, the former to be encouraged, the latter should be discouraged or factored into the treatment plant design.
- Premises serving beers may produce toxic caustic effluents due to the hygiene and cleaning regimes.
- The proportion of wastes from some sources can produce an effluent, which is difficult to treat, e.g. some Drive Through Fast Food establishments can have an effluent with a low organic content.

8 Hotels & Residential Centres

- Establish "style and type" of hotel e.g. Prestige (5^M), Bedroom only accommodation, Conference Centres, Resort Hotels with Sports and Spas, Treatment Centres, etc.
- Calculate total loading based on occupancy of at least 2 people per room.
- Some hotels regularly have 4 occupants per room.



- Consider and add other hotel activities and waste functions.

■ *The volume/BOD figures are based on an expectation that guests have an evening meal, drink and breakfast and that good kitchen practices are in place.*

- Add all other loads, considering non-resident uses, ie Lunches, Functions, Visiting Drinkers, Diners, etc.
- Consider periodicity of loads.
- Ensure residential and training centre loadings reflect the complete meal plan, i.e. allow for lunch and afternoon tea, sports, etc.
- Special Events. Check provision of temporary facilities, e.g. summer marquees and allow for appropriate loading.
- Consider any loads from outside catering.

9 Laundries

- Excepting domestic premises, it is assumed that all laundry functions are additional.
- For each premises, identify which laundry items are done in house or sent off site.
- Calculate the laundry load on the basis of the number of machines and the period of use.
- Sites with laundries must fit and maintain lint filters.

■ *The chemical load (detergents) inhibits biological treatment, the laundry waste percentage of the normal maximum Flow usually needs to be less than 30% of the total load.*

■ *Where the laundry percentage >30%, manufacturers select equipment on a different basis.*

■ *As a guide, where the hydraulic load from laundries is between 1-10%, system size increases by 10%, 11-20% increases by 20%, 21-30% increases by 30%.*

■ *Excess/surplus detergents (above the recommended quantities) can affect the biological process.*

■ *Discharge quality may be improved if operators use low/zero phosphate detergents.*

10 Toilet Blocks

- Figures can also be assessed according to the sanitary equipment and control system installed.

■ *Automatically flushed urinals use 10 litres per hour; a single flush should not use more than 1.5 litres.*

■ *Consider ladies and gents toilet facilities separately.*

11 Sports Clubs

- Calculate loadings on 100% usage for the sporting facility. The figure provided includes showering and toilet use by the sports person.
- Consider also the non-sporting uses, i.e. spectators' toilet use.
- Add drinkers, social members and staff.
- Add values for catering facilities.
- Check normal and exceptional catering provisions.

- A swimming pool with no associated sports centre may be calculated using the number of swimmers, assume a toilet use per person, and by adding values for showers and spectators. Check duration of visits and modify for extended use.

■ *Consider separate treatment or disposal of backwash waters from ancillary equipment, such as types of filtration and disinfectant removal in swimming pools.*

12 Golf Clubs

- The values within the data table allow for light snacks and toilet use.
- Calculate additional allowances for showers.
- Add values for other catering facilities (if other than light snacks).

13 Hospitals

- The nature of the facility affects the design values. Some nursing homes have very high hydraulic loads as a result of the use of bedpans and their sanitation. Consider any disinfection equipment installed.
- With drugs and hygiene requirements of hospitals adjust the equipment size to compensate for treatability factors.

■ *Disposal of unused/waste medicines is not permitted via the treatment facility.*

14 Caravan Sites

- Establish nature of communal blocks, i.e. toilet, shower usage, laundry, etc.
- Where laundry equipment is installed, count the number of machines on site and period of use. Where possible, identify specific commercial machine details for volume and wash cycle duration.

■ *Hydraulic loads of 100 litres per hour for 12 hours are not unusual.*

- Loading figures quoted assume that wastes from chemical toilets do not enter the system as they must not be allowed to enter into the treatment plant.

■ *A cesspool may be installed to receive chemical toilet waste for separate disposal.*

15 Installation

The following may affect which equipment is offered.

- The site.
- Location of treatment plant within the site.
- Invert depth of installation (where possible, locate to permit gravity flow into and out of the system).
- Pumping equipment.
- Installation requirements.

■ *Refer to manufacturer's specifications and installation manual.*

- Access for maintenance and servicing.

■ *Refer to manufacturer's specifications and maintenance instructions.*

- The need for a sample chamber.
- Discharge point.
- Soil percolation area or other tertiary treatment.



16 Documentation

Records of the loads used to select and recommend the type and size of treatment systems should be maintained by the specifier and the customer. A typical example follows.

Treatment system enquiry sizing sheet

Our Ref. 123456 **Date** 10th August 2003 **Site** ABC Hotel 3* Hotel **Client** New Architects & Consultants

| SOURCE OF WASTE Description | No of rooms Occupancy | | | FLOW LITRE / DAY | | BOD GRAMS / DAY | | NH ₃ | |
|--|-----------------------|----------|-------|------------------|--------------------|-----------------|-------------------|-----------------|---------------------------------|
| | No | Per Head | TOTAL | Per Head | TOTAL | Per Head | TOTAL | | |
| Rooms | 80 | 2 | 160 | 250 | 40000 | 94 | 15040 | 10 | 1600 |
| Bar drinkers | | | 120 | 12 | 1440 | 15 | 1800 | 5 | 600 |
| Non resident luxury meals | | | 150 | 30 | 4500 | 38 | 5700 | 4 | 600 |
| Staff, full-time day staff | | | 30 | 90 | 2700 | 38 | 1140 | 5 | 150 |
| Staff, part-time | | | 20 | 45 | 900 | 25 | 500 | 3 | 60 |
| Laundry – all sent off site | | | | | | | | | |
| Domestic washing machine for tea towels only | | | | 800 | | | | | |
| Total load(s) | | | | | 50340 | | 24180 | | 3010 |
| Effluent quality requested | | | | | 20 mg/l BOD | | 30 mg/l SS | | 20 mg/l NH₃ N |

Suggested type of plant: XYZ. **Invert:** 1.0m. **Power:** 3-phase. **Surface water:** all to be excluded from foul sewer. **Consent to discharge:** to be obtained from the Regulator. **Waste Disposal Units:** assumed that none are fitted. **Grease trap:** required size "125".

Notes

Swimming pool – present, used for guests only, all backwash wastes to be excluded. No function rooms or catering

Further information and guidance can be obtained from the British Water website – www.britishwater.co.uk

Please note the following statement by British Water

Subject as stated below, no responsibility, duty of care or liability whatsoever (whether in contract or tort or otherwise including, but not limited to, negligence) is or will be accepted by British Water, its officers, employees, agents or members to any user of this guidance or any other person in connection with or in relation to this guidance.

Subject as stated below, British Water, its officers, employees, agents and members do not accept any responsibility or liability for any loss or damage caused to any person who acts or refrains from acting as a result of anything contained in or omitted from this guidance or in reliance on the provisions of or material in this guidance, whether such loss or damage is caused by negligence or otherwise.

Nothing in this disclaimer shall be construed as excluding or limiting the liability of British Water or any of its officers, employees, agents or members for death or personal injury resulting from the negligence of such persons or for fraud.

This guidance does not constitute legal, technical or other advice and it should not be regarded as such. Anyone requiring advice on any of the matters referred to in this guidance, including on how to ensure compliance with any relevant legal or regulatory requirements, should consult their legal or other appropriate professional advisers.

Nothing in this guidance is intended to be or should be construed as advice on the merits of, or a recommendation in relation to, any particular product or product provider and no representation is made that any member of British Water operates or will operate in accordance with this guidance.

Each part of this disclaimer shall be construed as a separate and severable part, and if one or more parts is held to be invalid, unlawful or otherwise unenforceable, the remaining parts shall remain in full force and effect.

Company contact details are in the member list on the British Water website www.britishwater.co.uk

